

NEW AERUS MEDICAL UNIT TESTING – Complying with FDA Protocols in a FDA Certified Compliant Laboratory

Net Log Reduction Of MS2 Bacteriophage Virus Bioaerosol

RNA Virus

> **OVER 99.9999% REDUCTION
OF MS2 BACTERIOPHAGE VIRUS IN
ONLY 60 MINUTES!**




Results based on laboratory testing

Scientific testing has demonstrated the use of ActivePure® Technology to substantially reduce airborne and surface contaminants.

Field results may vary based on environmental conditions. These results have not been certified by the FDA.

Reduction of Airborne Contaminants MS2 bacteriophage RNA Virus

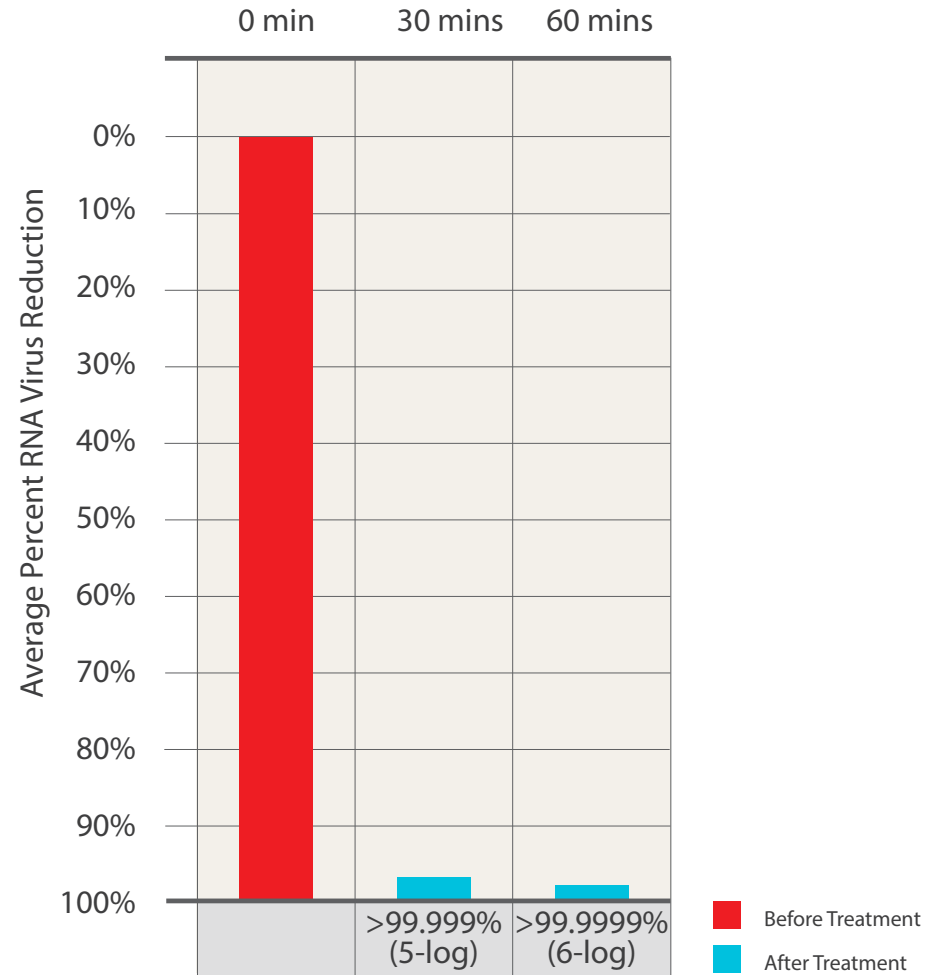

NEW AERUS MEDICAL UNIT TESTING – Complying with FDA Protocols in a FDA Certified Compliant Laboratory

Net Log Reduction Phi-X147 Of Bacteriophage Virus Bioaerosol

DNA Virus

> **OVER 99.995% REDUCTION
OF PHI-X147 BACTERIOPHAGE VIRUS
IN ONLY 60 MINUTES!**




Results based on laboratory testing

Scientific testing has demonstrated the use of ActivePure® Technology to substantially reduce airborne and surface contaminants.

Field results may vary based on environmental conditions. These results have not been certified by the FDA.

**Reduction of Airborne Contaminants
Phi-X147 bacteriophage DNA Virus**

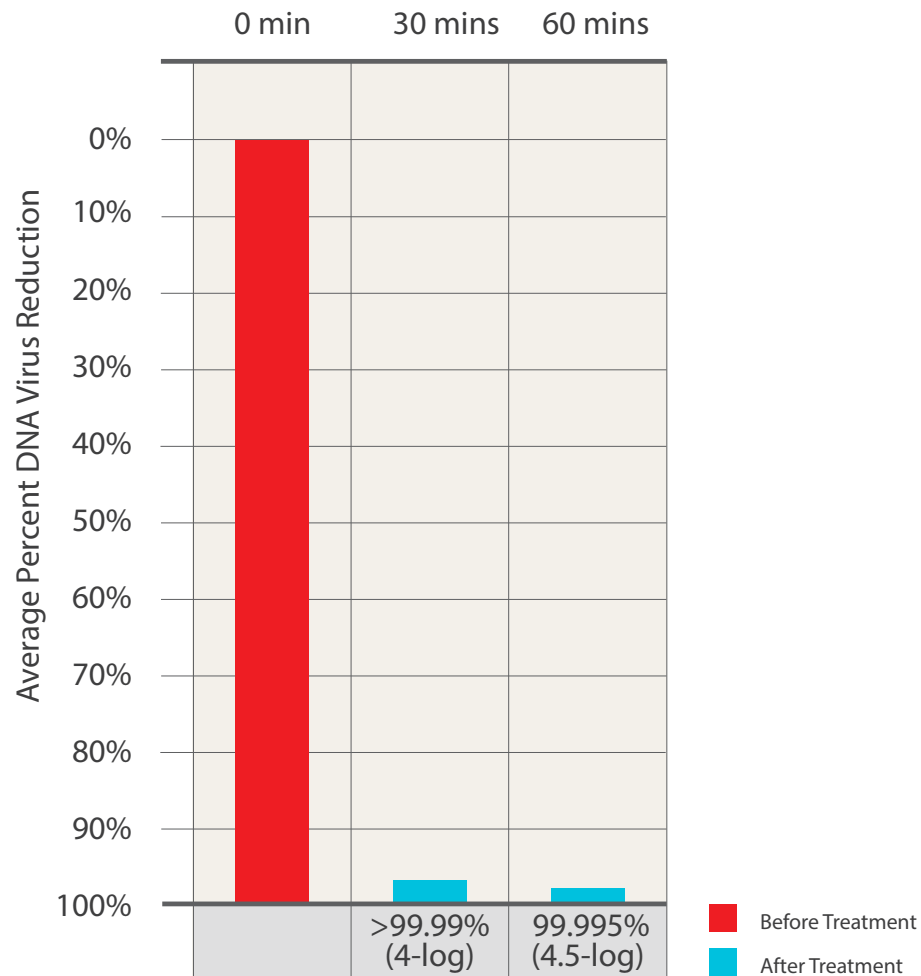

NEW AERUS MEDICAL UNIT TESTING – Complying with FDA Protocols in a FDA Certified Compliant Laboratory

Net Log Reduction Of Staphylococcus Epidermidis Bioaerosol

Gram-positive Bacteria

> **OVER 99.9999% REDUCTION
OF STAPHYLOCOCCUS EPIDERMIDIS
IN ONLY 60 MINUTES!**




Results based on laboratory testing

Scientific testing has demonstrated the use of ActivePure® Technology to substantially reduce airborne and surface contaminants.

Field results may vary based on environmental conditions. These results have not been certified by the FDA.

**Reduction of Airborne Contaminants
Staphylococcus epidermidis – Gram-positive Bacteria**

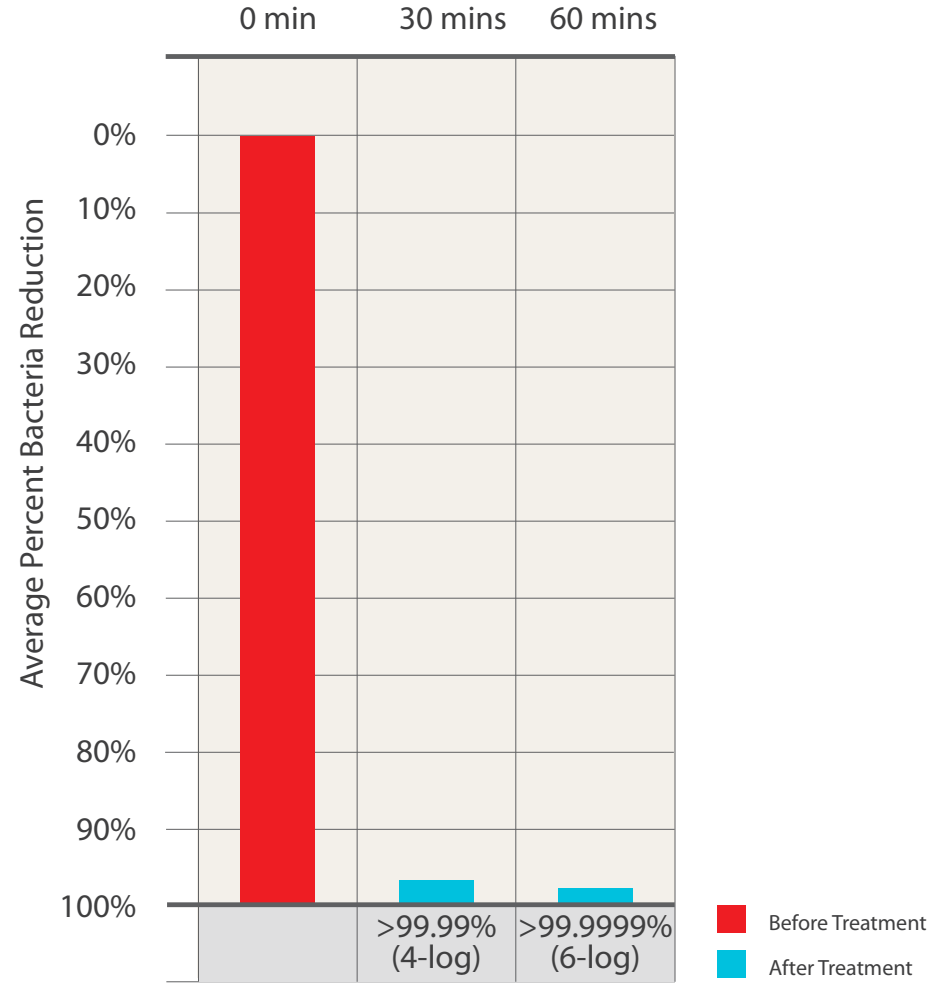

NEW AERUS MEDICAL UNIT TESTING – Complying with FDA Protocols in a FDA Certified Compliant Laboratory

Net Log Reduction Erwinia Herbicola Bioaerosol

Gram-negative Bacteria

> **OVER 99.999% REDUCTION
OF ERWINIA HERBICOLA IN
ONLY 60 MINUTES!**




Results based on laboratory testing

Scientific testing has demonstrated the use of ActivePure® Technology to substantially reduce airborne and surface contaminants.

Field results may vary based on environmental conditions. These results have not been certified by the FDA.

Reduction of Airborne Contaminants Erwinia herbicola – Gram-negative Bacteria

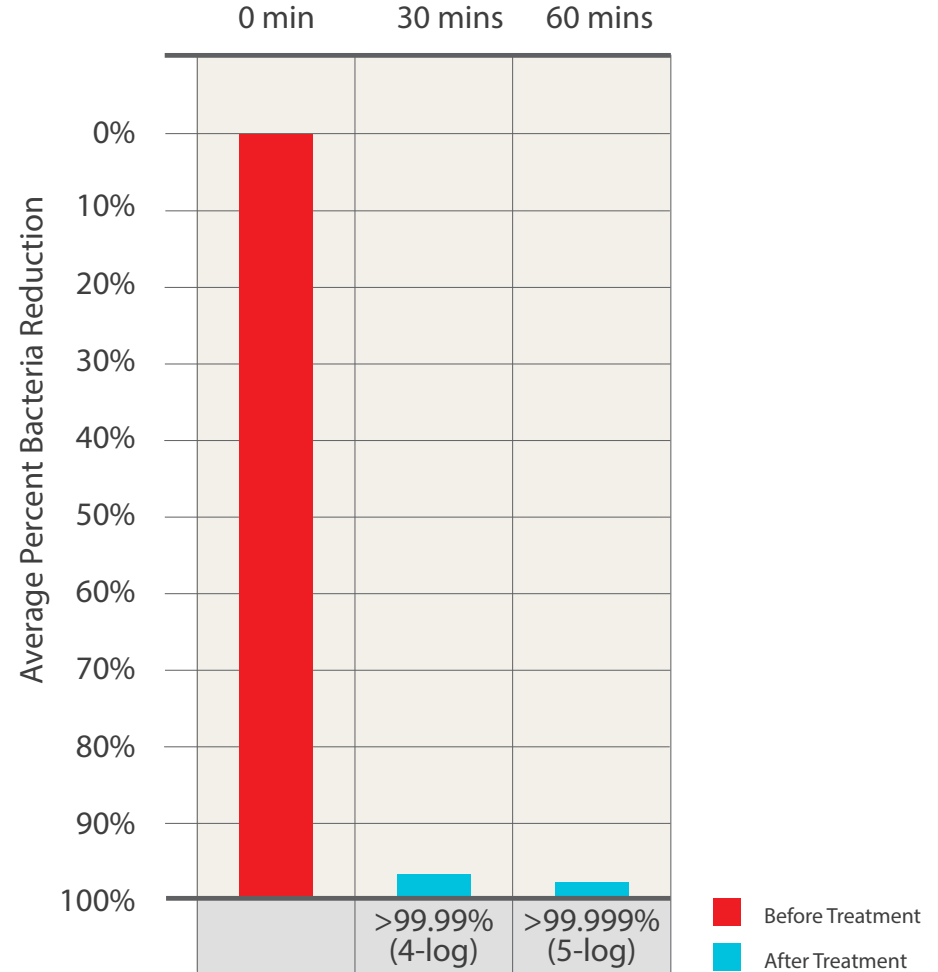


NEW AERUS MEDICAL UNIT TESTING – Complying with FDA Protocols in a FDA Certified Compliant Laboratory

Net Log Reduction Of Aspergillus Niger (fungal spores)

Mold

> **OVER 99.99% REDUCTION
OF ASPERGILLUS NIGER IN ONLY 60
MINUTES!**




Results based on laboratory testing

Scientific testing has demonstrated the use of ActivePure® Technology to substantially reduce airborne and surface contaminants.

Field results may vary based on environmental conditions. These results have not been certified by the FDA.

Reduction of Airborne Contaminants Aspergillus niger

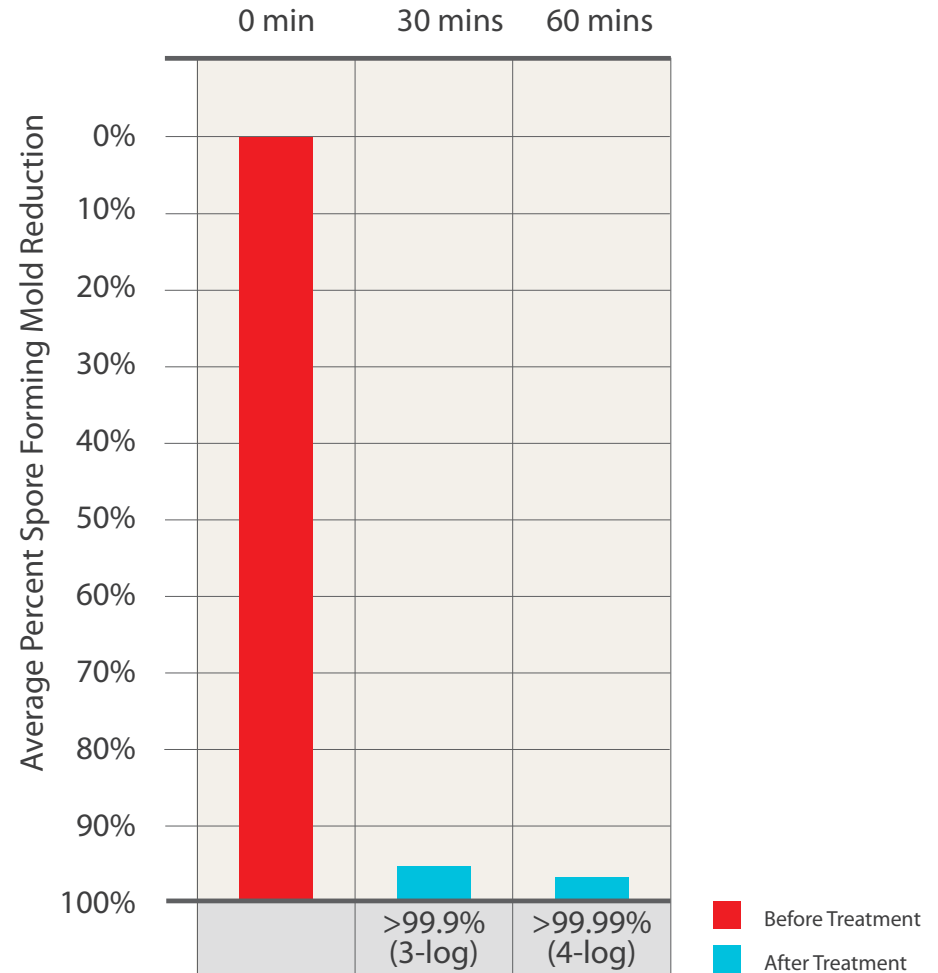


NEW AERUS MEDICAL UNIT TESTING – Complying with FDA Protocols in a FDA Certified Compliant Laboratory

Net Log Reduction Of Bacillus Globigii (bacterial spores)

Mold

> **OVER 99.99% REDUCTION OF BACILLUS GLOBIGI IN ONLY 60 MINUTES!**



Results based on laboratory testing

Scientific testing has demonstrated the use of ActivePure® Technology to substantially reduce airborne and surface contaminants.

Field results may vary based on environmental conditions. These results have not been certified by the FDA.

Reduction of Airborne Contaminants Bacillus globigii

